


CRUSHED STONE OR CRUSHED GRAVEL, CA-7 CLASS 1A TO PROVIDE ADEQUATE SUPPORT.

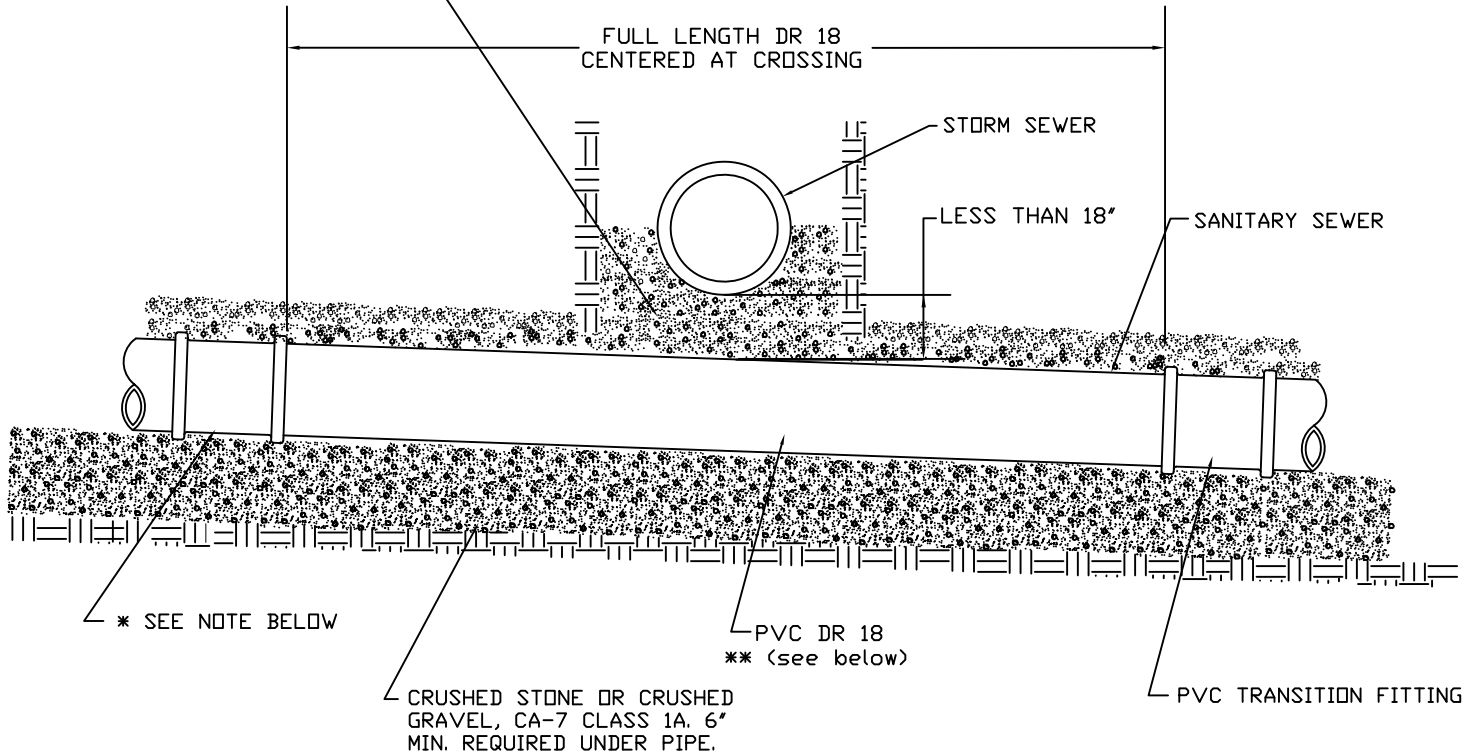

NOTE

* SHOW DR 18 THROUGHOUT CONFLICT AREA, TO ANY PROPOSED MANHOLE, IF SAID STRUCTURE IS WITHIN 30' OF CENTERLINE OF THE CROSSING.

** IN LIEU OF ABOVE STANDARD METHOD, DR 18 MAY BE INSTALLED MANHOLE TO MANHOLE.

SANITARY SEWER AT STORM SEWER CROSSING

Fox Metro
Water Reclamation District

DESIGNED	FMWRD	REVISION	2017
DRAWN	KZ	E Note Revision	01/30/06
APPROVED	KZ, MF	F Fitting & Note Revision	03/19/07
DATE	05-15-00	G Dimension Change	04/30/08
SCALE	NTS	H Full Length DR 18 Note Rev.	02/09/17
SHEET	1	CAD DWG.	REVISION
OF	1	JOB NO.	H