


REQUIRED WHEN A 10' MINIMUM SEPARATION IS
NOT POSSIBLE FOR WATER AND SEWER SERVICES

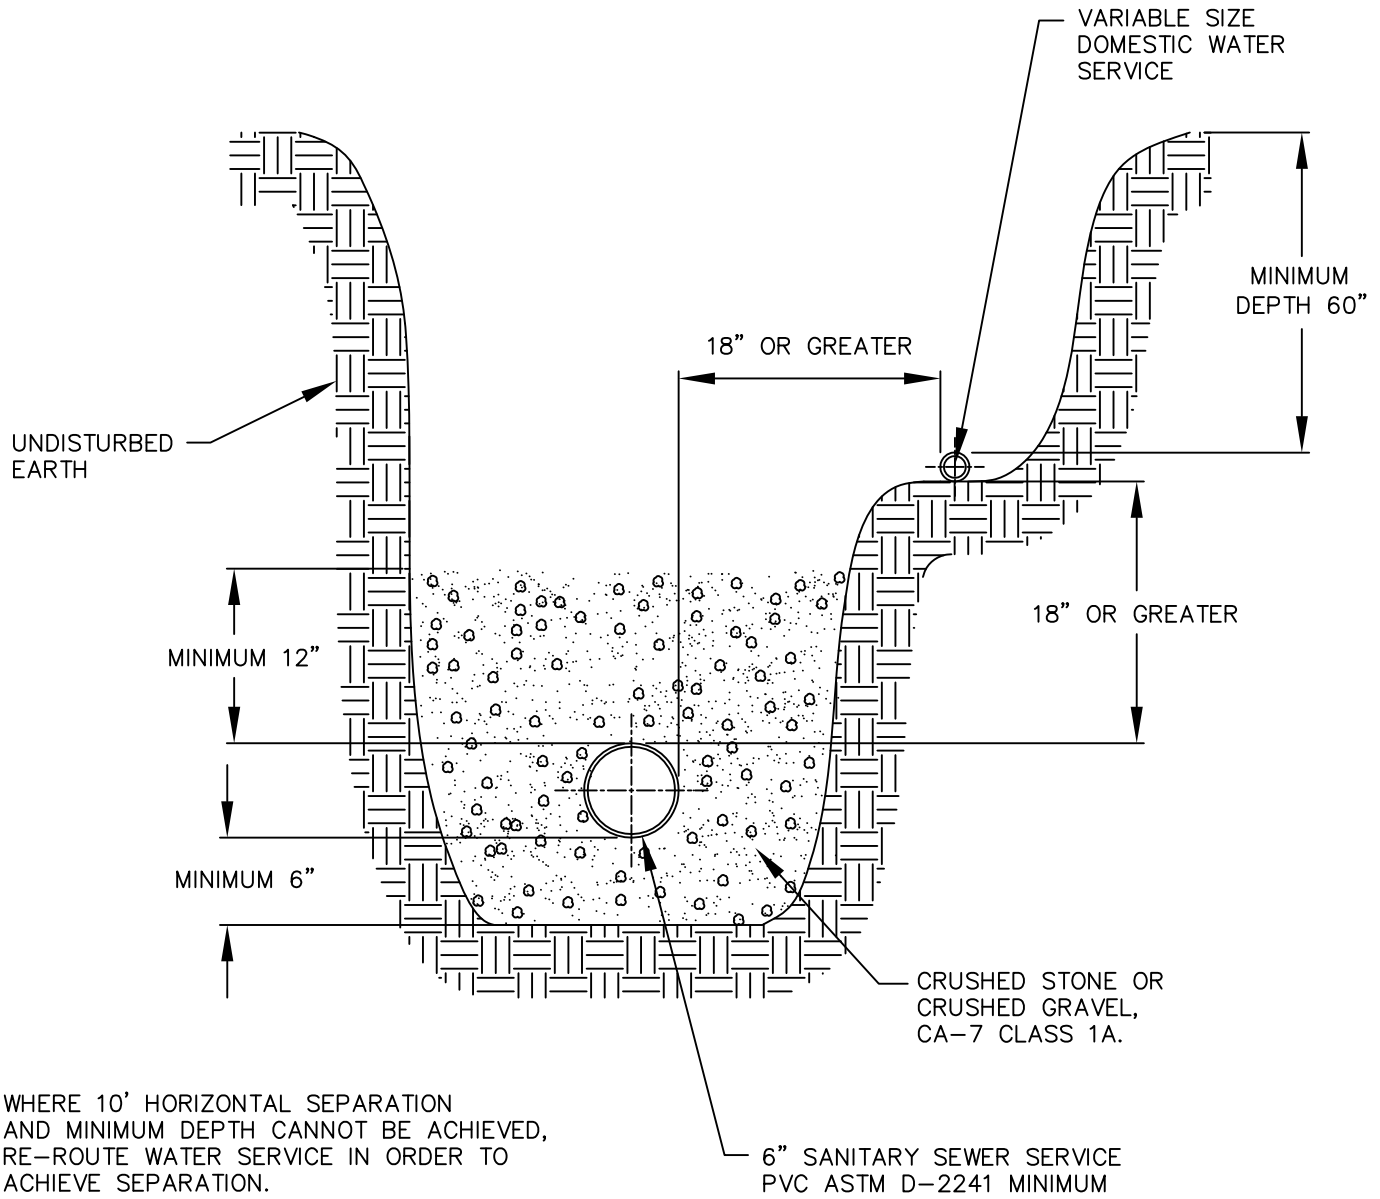

NOTE

INSTALL PER "77 ILL. ADMIN. CODE PART 890
ILLINOIS PLUMBING CODE" LATEST EDITION.

**SANITARY SEWER SERVICE & POTABLE
WATER SERVICE SEPARATION**

Fox Metro
Water Reclamation District

DESIGNED FMWRD	REVISION	2017
DRAWN KZ	A Revised 2004	01/05/04
APPROVED KZ, MF	B Depth Note	02/03/05
DATE 08-28-00	C Note Revision	01/30/06
SCALE NTS		
SHEET 1	CAD DWG.	REVISION C
OF 1	JOB NO.	