


CRUSHED STONE OR CRUSHED GRAVEL, CA-7 CLASS 1A TO PROVIDE ADEQUATE SUPPORT.

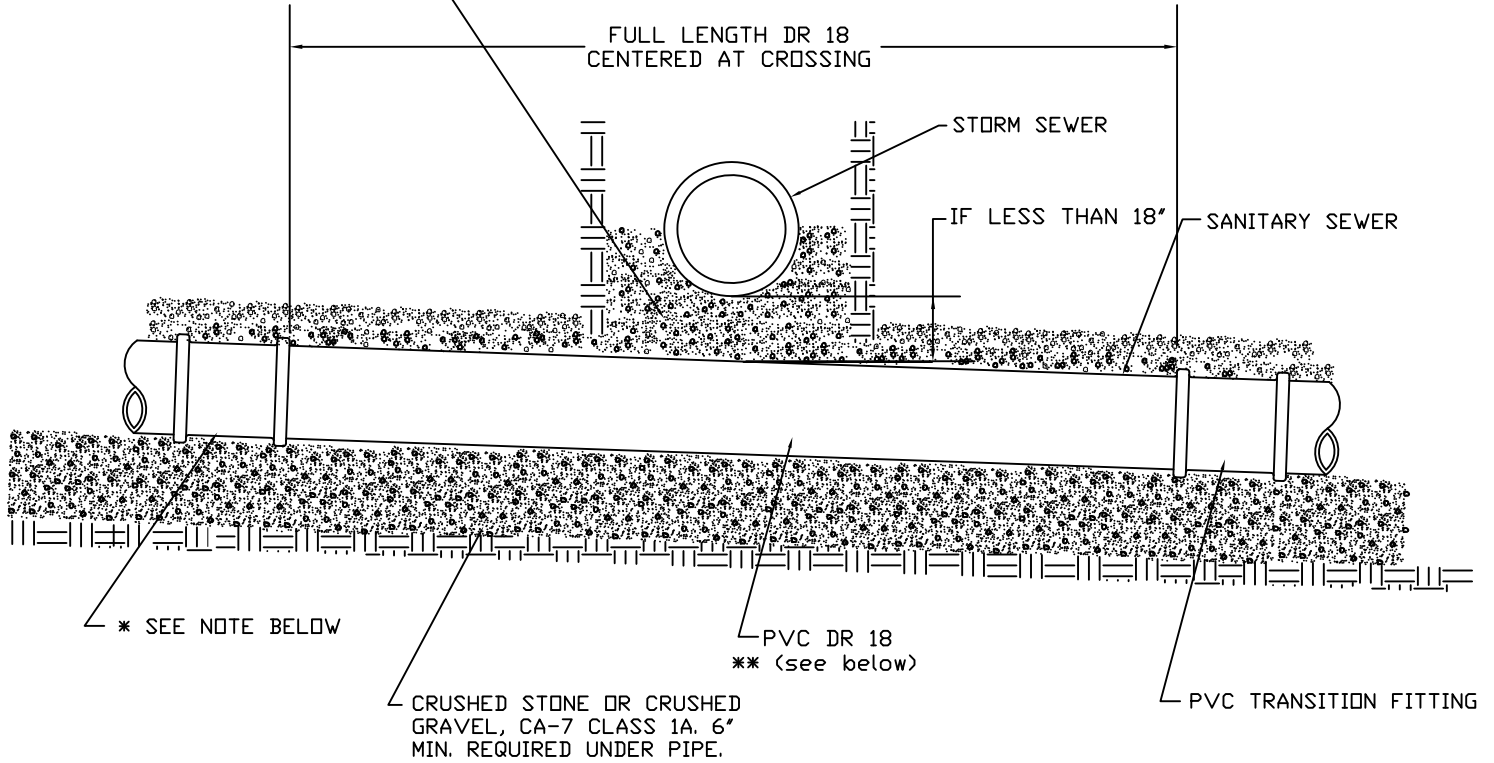

NOTE

* SHOW DR 18 TO 10' BEYOND EACH SIDE-WALL OF THE STORM SEWER. IF CONFLICT AREA IS WITHIN 30' OF A MANHOLE, CONSTRUCT DR 18 TO SAID MANHOLE.

** IN LIEU OF ABOVE STANDARD METHOD, DR 18 MAY BE INSTALLED MANHOLE TO MANHOLE.

SANITARY SEWER CROSSING UNDER STORM SEWER

Fox Metro
Water Reclamation District

DESIGNED	FMWRD	REVISION	2022
DRAWN	KZ	G	Dimension Change 04/30/08
APPROVED	KZ, MF	H	Full Length DR 18 Note Rev. 02/09/17
DATE	05-15-00	I	Rev. "NOTE" 10' beyond side wall 7/22/2020
SCALE	NTS	J	Added "if" to "Less than 18" note 1/26/2021
SHEET	1	CAD DWG.	REVISION J
OF	1	JOB NO.	