


REQUIRED WHEN A 10' MINIMUM SEPARATION IS
NOT POSSIBLE FOR WATER AND SEWER SERVICES

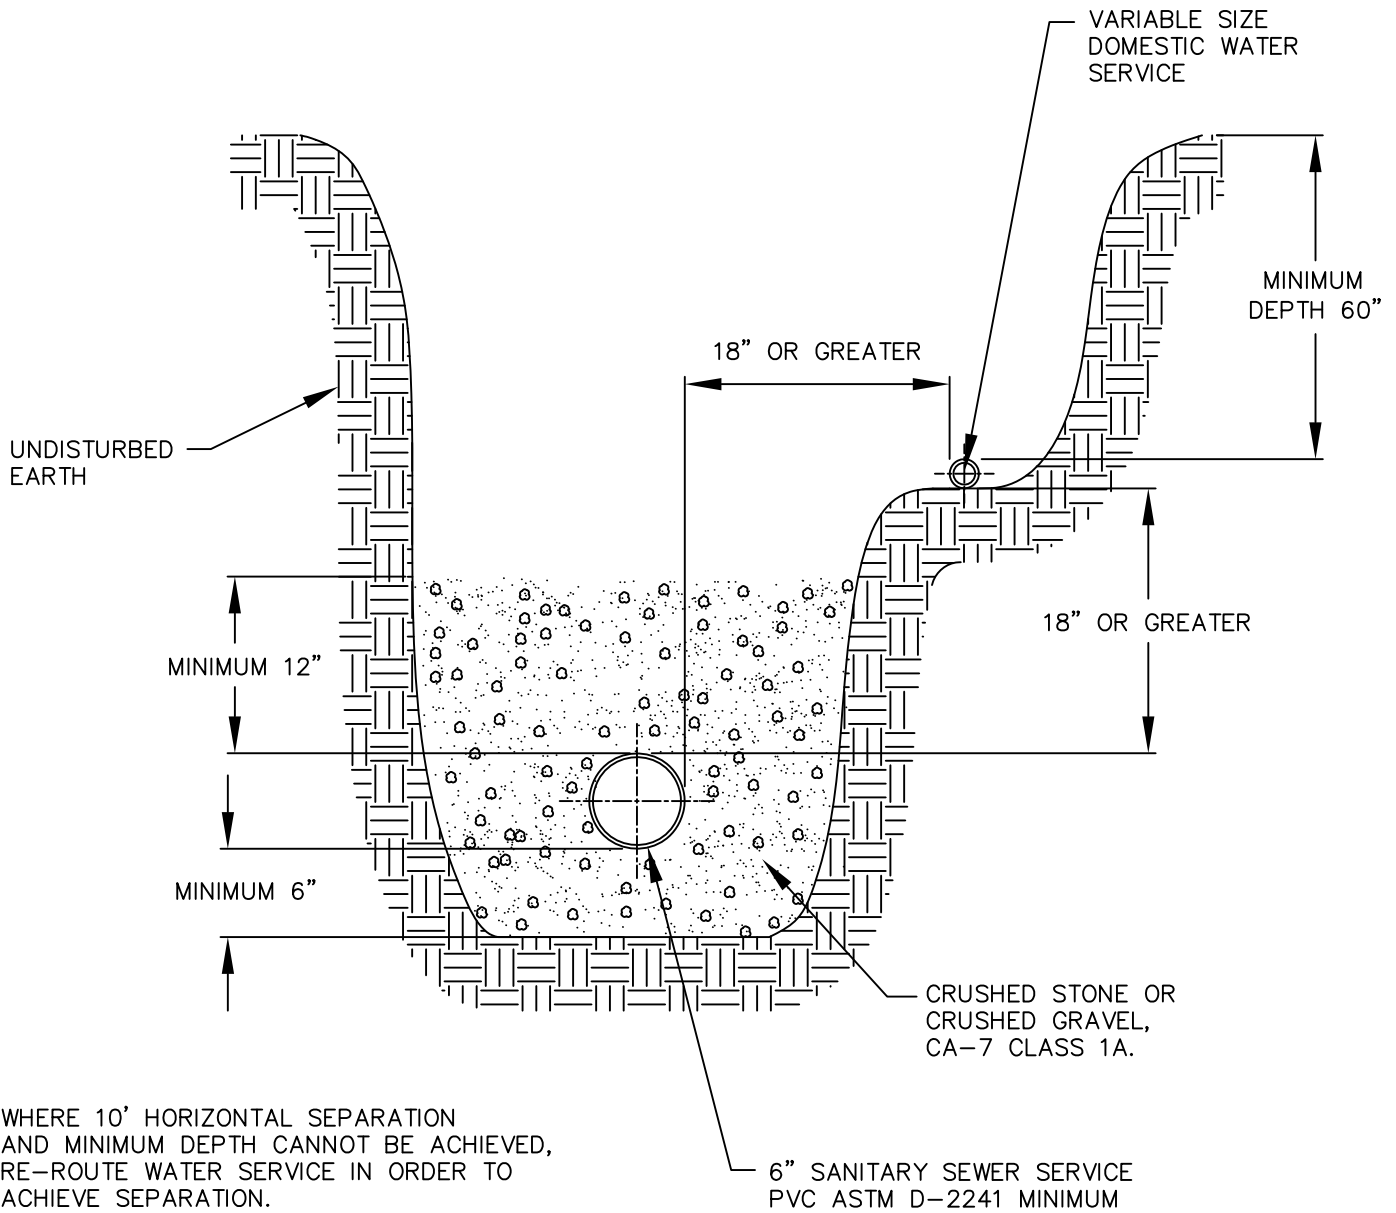

NOTE

INSTALL PER "77 ILL. ADMIN. CODE PART 890
ILLINOIS PLUMBING CODE" LATEST EDITION.

**SANITARY SEWER SERVICE & POTABLE
WATER SERVICE SEPARATION**

Fox Metro
Water Reclamation District

| | | | |
|----------|----------|----------|------------------------|
| DESIGNED | FMWRD | REVISION | 2022 |
| DRAWN | KZ | A | Revised 2004 01/05/04 |
| APPROVED | KZ, MF | B | Depth Note 02/03/05 |
| DATE | 08-28-00 | C | Note Revision 01/30/06 |
| SCALE | NTS | | |
| SHEET | 1 | CAD DWG. | REVISION C |
| OF | 1 | JOB NO. | |