


SCHEDULE 40 PVC OR OTHER CITY/VILLAGE APPROVED PIPE

6" PVC, INCLUDING A FULL-SIZED CLEANOUT, REQUIRED PER FOX METRO SPECIFICATION

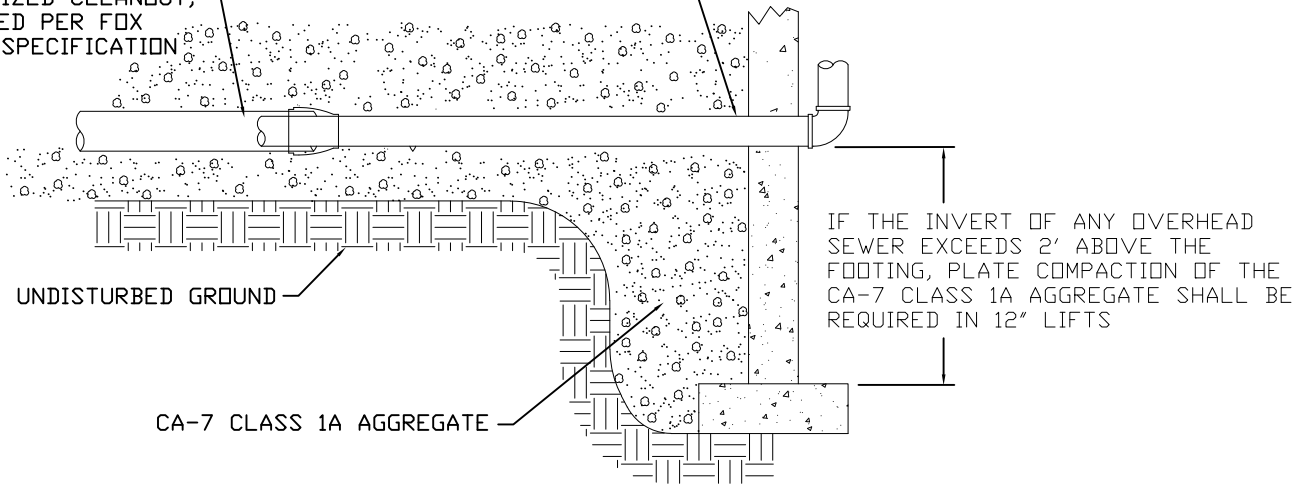

TRENCH DETAIL FOR SANITARY SERVICES & MAINS

Fox Metro
Water Reclamation District

DESIGNED FMWRD	REVISION	2022
DRAWN KZ	D Stone Note	01/30/06
APPROVED KZ, MF	E 07 Revisions	03/19/07
DATE 05-12-00	F Overdig Compaction Note	03/08/17
SCALE NTS	G Full-Sized C.O. Req'd Note	07/23/2020
SHEET 1	CAD DWG.	REVISION G
OF 1	JOB NO.	